


NANOCOLOR® Härte Ca/Mg

Hardness Ca/Mg / Dureté Ca/Mg / Durezza Ca/Mg












Test 0-44
REF 985044

Methode / Method / Méthode / Método

0443 1.0–20.0 °d
5–50 mg/L Mg²⁺
10–100 mg/L Ca²⁺


540 nm

Min	20–80 %		Max
5	14	41	50 mg/L Mg ²⁺
10	28	82	100 mg/L Ca ²⁺

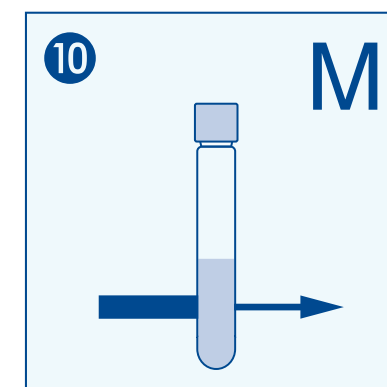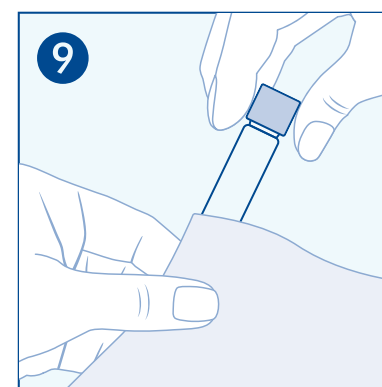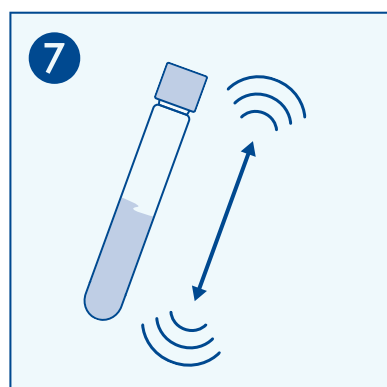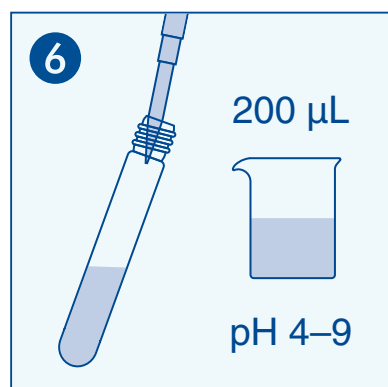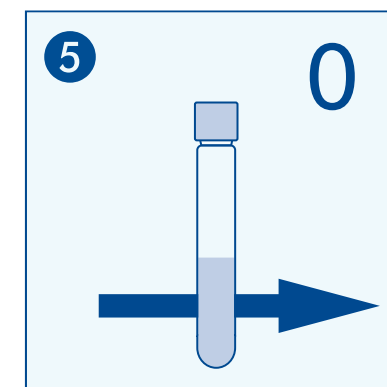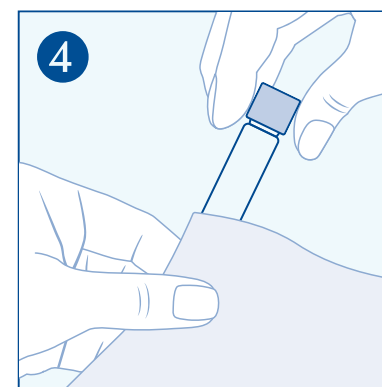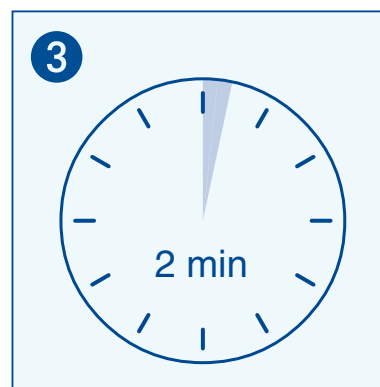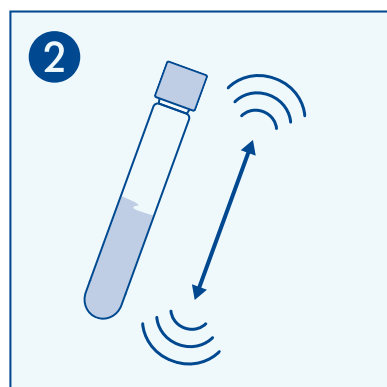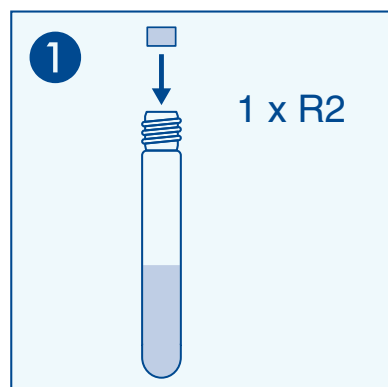

NANOCOLOR® Härte Ca / Mg

Hardness Ca / Mg / Dureté Ca / Mg / Durezza Ca / Mg



Test 0-44
REF 985044

Methode / Method / Méthode / Método

540 nm

0444 1.0–25.0 °e
 0445 2.0–36.0 °f
 0446 0.2–3.6 mmol/L
 0447 25–250 mg/L CaCO₃

Min	20–80 %		Max
5	14	41	50 mg/L Mg ²⁺
10	28	82	100 mg/L Ca ²⁺

